


3D VIEW

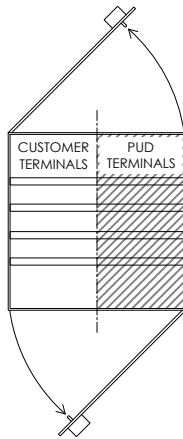


TOP VIEW

Notes:

- A. Route cable around center sump, leave at least 6 feet of slack. Cable may be coiled if needed.
- B. Each phase must be connected to its own bus bar, do not cross phases. Neutrals must be connected to a separate bus bar.
- C. One half of the pedestal is reserved for Cowlitz PUD conductors only, the other half is reserved for customer conductors only.
- D. Cabinet lid (not shown) is fully removable.
- E. Set vault so that the top of the vault lid is 2-6 inches above final grade.

| ITEM | QTY | ITEM #  | MATERIAL DESCRIPTION                                                                         | AU #    |
|------|-----|---------|----------------------------------------------------------------------------------------------|---------|
| 1    | 1   | 585-128 | 4'X4'X4' concrete vault                                                                      | 970-062 |
| 2    | 1   | 585-116 | Concrete vault lid, 4'x4' w/ 24"x30" blockout, lifting anchors, and 1/2"-13 threaded inserts |         |
| 1    | 1   | 585-139 | 3-phase secondary pedestal, 22-position                                                      | 980-035 |
| 4    | 2   | 808-698 | Tie plate, 5"x2", 9/16" thru-hole                                                            |         |
| 5    | 2   | 801-515 | 1/2" stainless steel flat washer                                                             |         |
| 6    | 2   | 801-565 | 1/2"-13 x 3" stainless steel hex head screw                                                  |         |

|                                                                                                                                                                                                             |                                                                                                           |             |                                                     |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------|-------------|-----------------------------------------------------|
|  <p><b>PUBLIC UTILITY DISTRICT NO. 1</b><br/>Cowlitz County, Washington<br/>961 12th Avenue<br/>Longview, Washington</p> | <b>STANDARDS</b><br>CONSTRUCTION STANDARDS<br>SECONDARY & SERVICE ENTRANCES<br>3-PHASE SECONDARY PEDESTAL |             | REV 0    DATE 5/8/25    DESCRIPTION Initial release |
|                                                                                                                                                                                                             | Designed MJD                                                                                              | Checked DPT | Standards Approved <i>[Signature]</i>               |